


# EVAPCO, INC.



TITLE ELECTRIC WATER LEVEL CONTROL LOCATION

UNIT: INDUCED DRAFT TOWER

DWG. # ELT2MW2C-DB

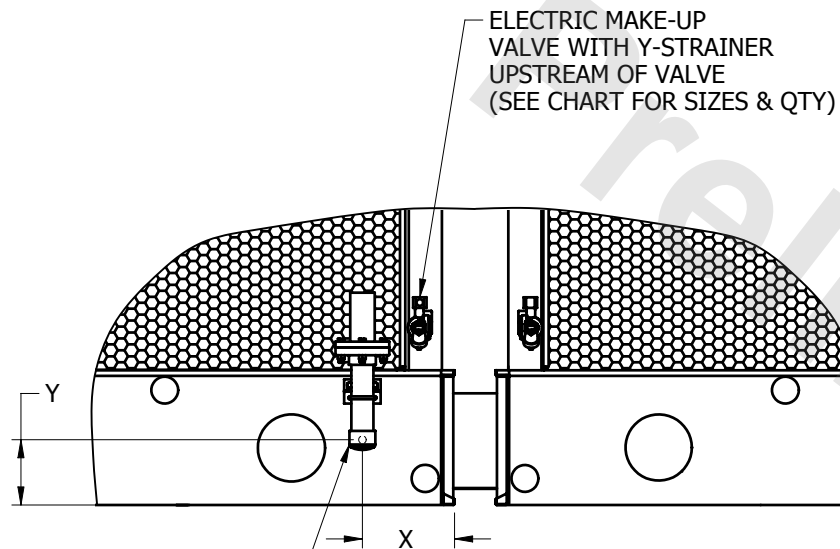

LEVEL PROBE STANDPIPE  
ASSEMBLY 060-00027SA  
(SEE CHART FOR QTY)

CONN. END VIEW

ELECTRIC MAKE-UP  
VALVE WITH Y-STRAINER  
UPSTREAM OF VALVE  
(SEE CHART FOR SIZES & QTY)

UNIT SELECTED	BOX SIZE	VALVE			Y-STRAINER			STANDPIPE		
		QTY	SIZE	PART NO.	QTY	SIZE	PART NO.	QTY	X	Y
<input type="checkbox"/>	17x10.5 - 12	2	1 [25]	017-00153P	2	1 [25]	017-00280P	1	12 [305]	8 1/2 [216]
<input type="checkbox"/>	17x14	2	1 1/2 [40]	017-00154P	2	1 1/2 [40]	017-00281P	1	12 [305]	8 1/2 [216]
<input type="checkbox"/>	24x18 - 20	2	2 [50]	017-00155P	2	2 [50]	017-00282P	1	12 [305]	8 1/2 [216]
<input type="checkbox"/>	28x24	2	2 [50]	017-00155P	2	2 [50]	017-00282P	1	16 [392]	10 1/2 [257]
<input type="checkbox"/>	6MX12-18	2	2 [50]	017-00155P	2	2 [50]	017-00282P	1	12 [305]	8 1/2 [216]

## NOTES:

1. PIPING BY OTHERS.
2. LEVEL PROBE STANDPIPE ASSEMBLY, MAKE-UP VALVE AND Y-STRAINER TO SHIP LOOSE FOR FIELD MOUNTING BY OTHERS.
3. SEE CERTIFIED PRINT FOR MAKE-UP LOCATION.
4. STANDPIPE TO BE HEAT TRACED AND INSULATED FOR WINTER OPERATION (BY OTHERS).
5. THE ELECTRONIC WATER LEVEL CONTROL ON THIS UNIT WILL MAINTAIN THE PROPER OPERATING WATER LEVEL.  
HOWEVER, BEFORE INITIAL START-UP THE UNIT MUST BE MANUALLY FILLED TO WITHIN 1" OF THE OVERFLOW.
6. FOR EASE OF MAINTENANCE, A SHUT-OFF VALVE IS RECOMMENDED UPSTREAM OF Y-STRAINER.
7. DIMENSIONS LISTED AS FOLLOWS: ENGLISH IN  
[METRIC] [mm]