

UNIT MTC-147A TITLE CONCRETE SUPPORT PIER LAYOUT

EVAPCO, INC. Evapeo



DWG. # CPL-MT0808-DRB SCALE DRAWN BY N.T.S. JLG

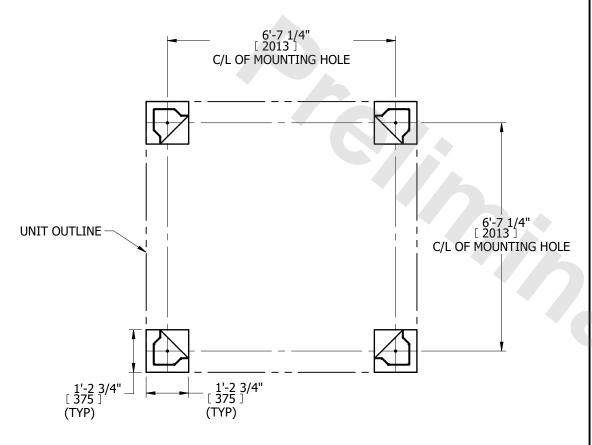

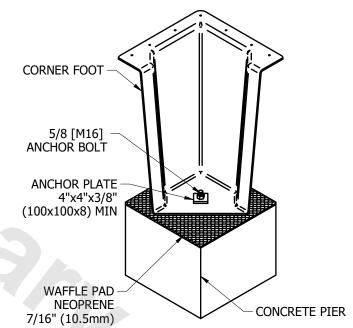

## NOTES:

- 1. CONCRETE PIERS AND ANCHOR HARDWARE ARE TO BE FURNISHED BY OTHERS. ANCHOR HARDWARE TO BE 5/8" (16mm) BOLT.
- 2. CONCRETE PIER SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY PLACING SHIMS BETWEEN THE UNIT AND THE SUPPORTING PIER.
- 3. THE FACTORY RECOMMENDED SUPPORT CONFIGURATION IS SHOWN. CONSULT THE FACTORY FOR ALTERNATE SUPPORT CONFIGURATIONS.