


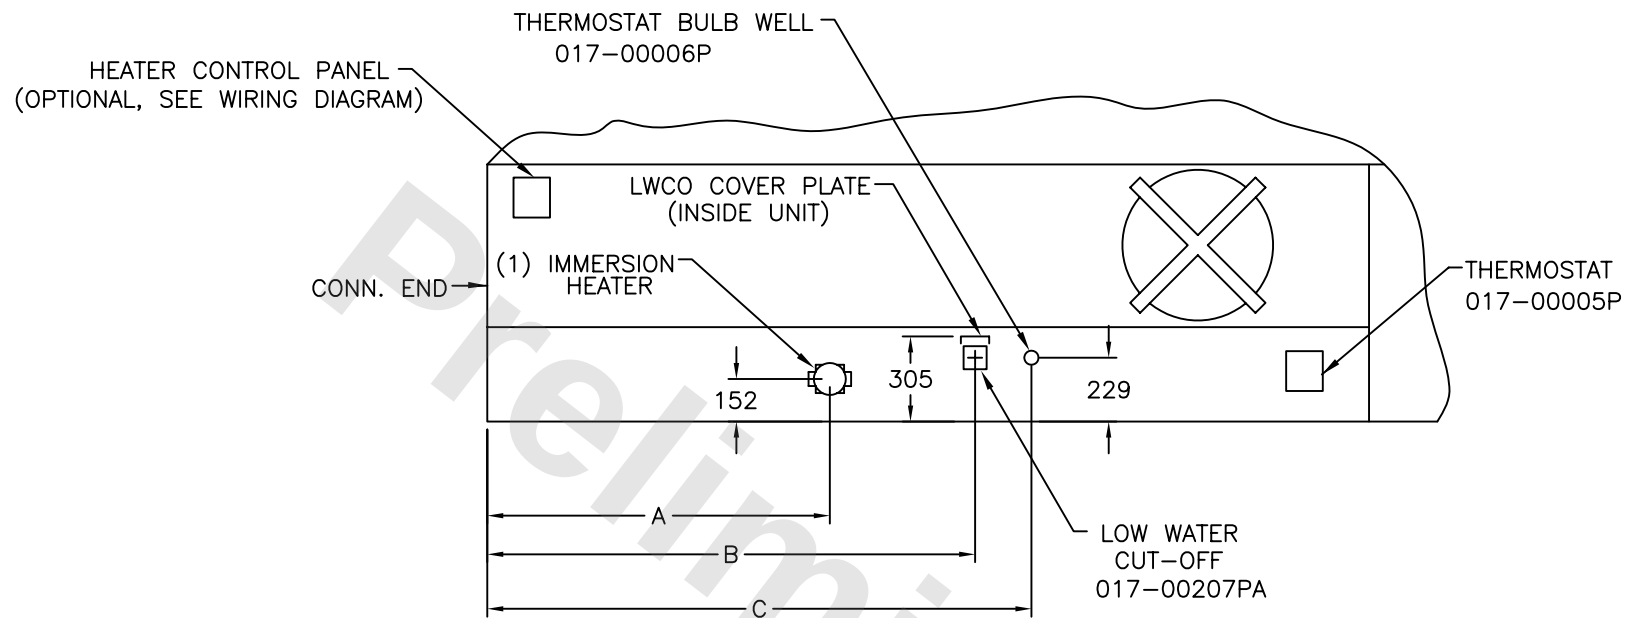

SIDE VIEW  
ALL LP/LR UNITS

| UNITS          | A    | B    | C    |
|----------------|------|------|------|
| 3 X 6, 5 X 6   | 432  | 1168 | 1321 |
| 5 X 9, 8 X 9   | 1321 | 1981 | 2134 |
| 5 X 12, 8 X 12 | 2032 | 2997 | 3150 |

NOTES:

1. A MINIMUM OF CLEARANCE IS REQUIRED BETWEEN THE HEATER OUTLET BOX AND THE NEAREST OBSTRUCTION FOR REMOVAL OF THE HEATER.
2. ALL NIPPLES ON UNIT ARE NOT SHOWN IN ORDER TO CLARIFY HEATER COMPONENT LOCATIONS.
3. ALL HEATER COMPONENTS BY EVAPCO ARE FACTORY MOUNTED WHEN POSSIBLE.



HEATER  
LOCATION

HLALOOML-MA