
eco-LRWB 3-2F6-Z

UNIT

TITLE

STEEL SUPPORT CONFIGURATION

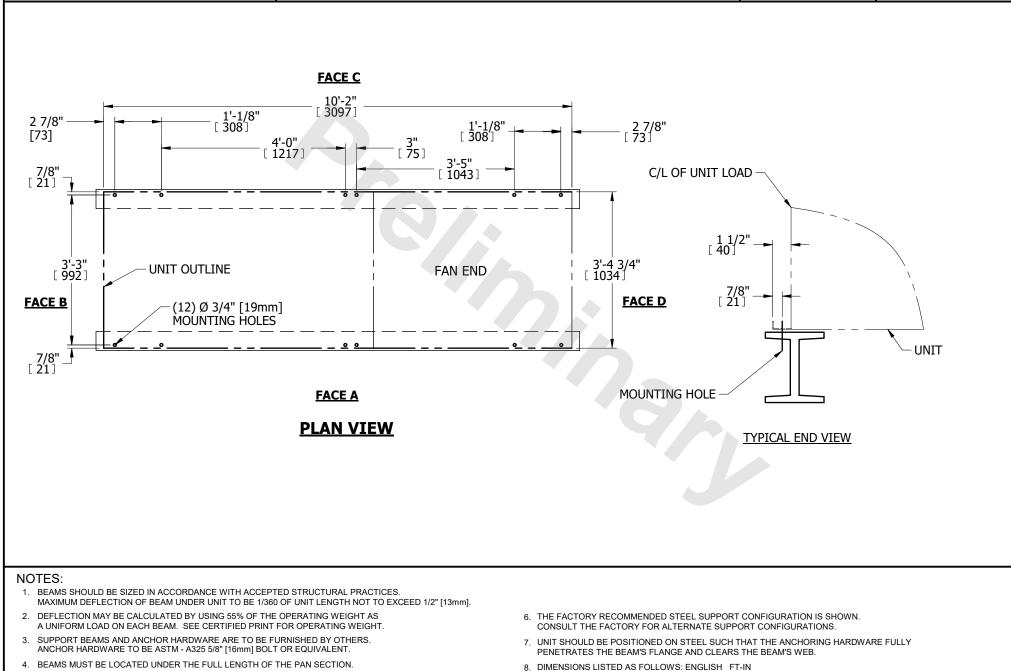

EVAPCO, INC.

DWG. #

SCALE

[METRIC] [mm]

N.T.S.

SLAL30306-DC

DRAWN BY

JLG

5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.