

UNIT MTW 10-3H10 TITLE CONCRETE SUPPORT PIER LAYOUT


EVAPCO, INC. Evapeo



DWG. # CPL-MC1010-DRC DRAWN BY SCALE N.T.S. JLG

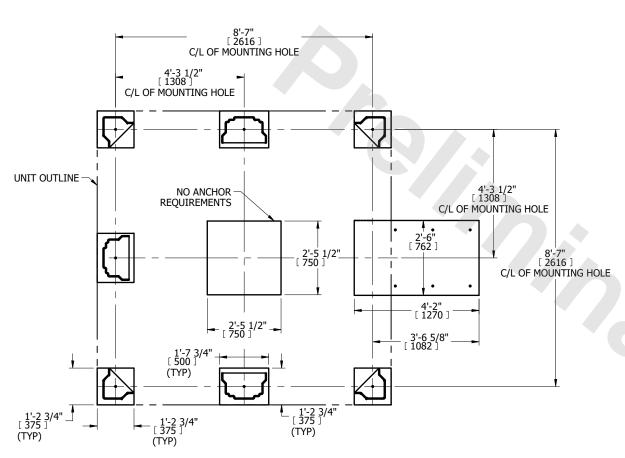

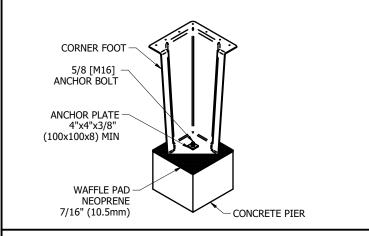

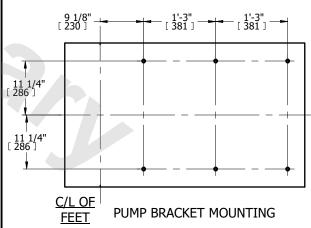

NOTES:

- 1. CONCRETE PIERS AND ANCHOR HARDWARE ARE TO BE FURNISHED BY OTHERS. ANCHOR HARDWARE TO BE 5/8" (16mm) BOLT.
- 2. CONCRETE PIER SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY PLACING SHIMS BETWEEN THE UNIT AND THE SUPPORTING PIER.
- 3. THE FACTORY RECOMMENDED SUPPORT CONFIGURATION IS SHOWN. CONSULT THE FACTORY FOR ALTERNATE SUPPORT CONFIGURATIONS.