



UNIT	MTT 18-3J8
TITLE	CONCRETE SUPPORT PIER LAYOUT

EVAPCO, INC.

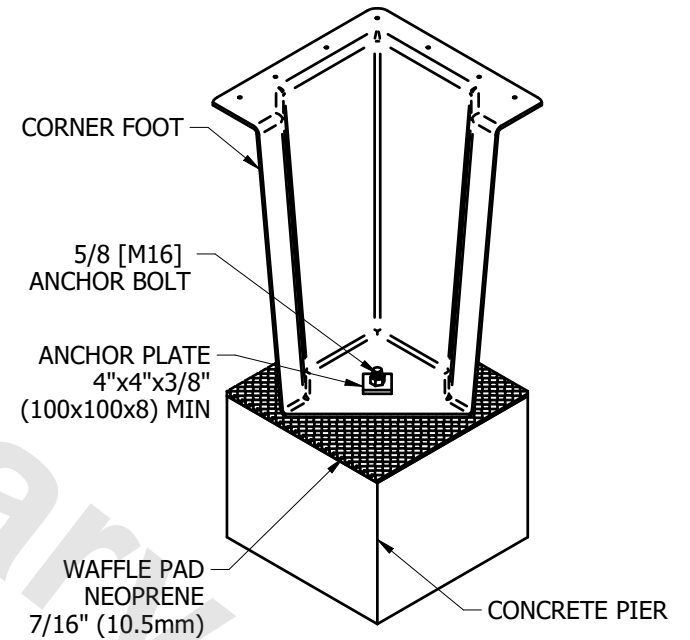

DWG. #	CPL-MT0808-DRB	
SCALE	N.T.S.	DRAWN BY JLG

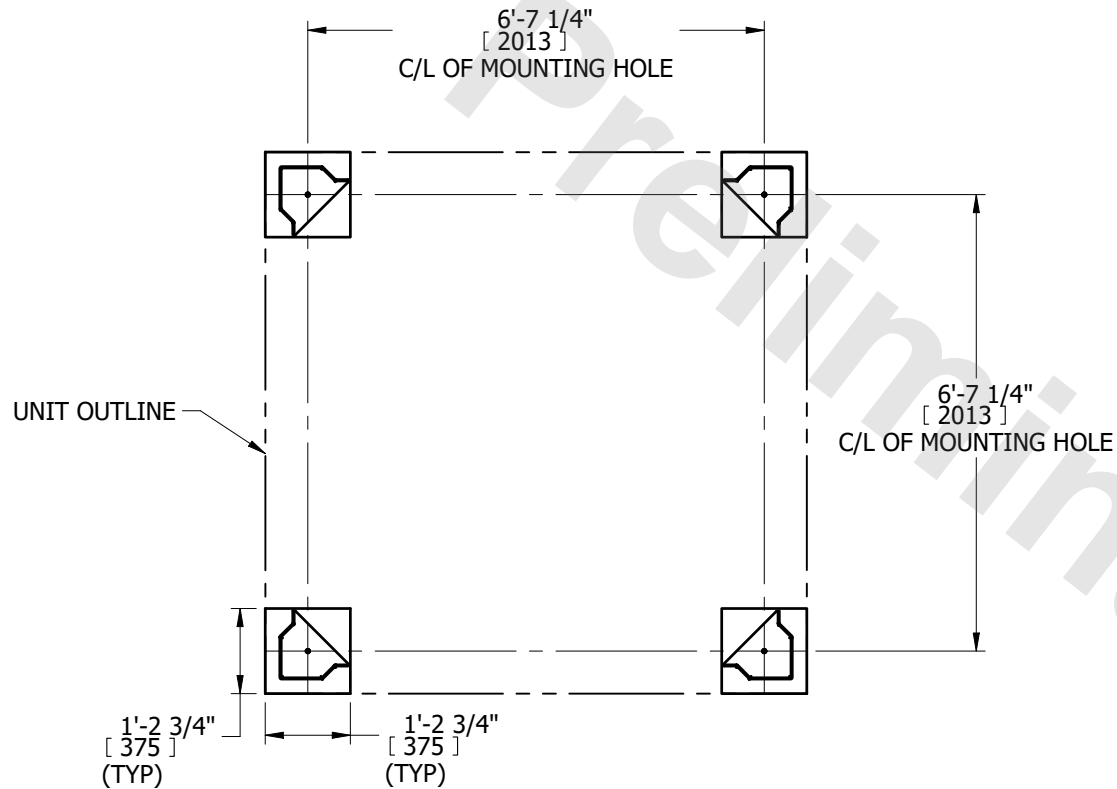

NOTES:

1. CONCRETE PIERS AND ANCHOR HARDWARE ARE TO BE FURNISHED BY OTHERS.
ANCHOR HARDWARE TO BE 5/8" (16mm) BOLT.
2. CONCRETE PIER SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY PLACING SHIMS BETWEEN THE UNIT AND THE SUPPORTING PIER.
3. THE FACTORY RECOMMENDED SUPPORT CONFIGURATION IS SHOWN.
CONSULT THE FACTORY FOR ALTERNATE SUPPORT CONFIGURATIONS.